

MODEL L007

Installation and Operating Manual

**SIDE MOUNTED
LIQUID LEVEL
FLOAT SWITCH**



Innovative Solutions

60 Great Hill Road
ph: 203-729-6434

Naugatuck, CT 06770
fax: 203-729-6696

www.innovativesensing.com

Read this Manual Before Installing

This manual provides information on the L007 Float Level Switch. It is important that all instructions are read carefully and followed in sequence. Detailed installation and wiring instructions are included in this manual.

Conventions Used in this Manual

Certain conventions are used in this manual to convey specific types of information. General technical material, support data, and safety information are presented in narrative form. The following styles are used for notes, cautions, and warnings.

NOTES

Notes contain information that augments or clarifies an operating step. Notes do not normally contain actions. They follow the procedural steps to which they refer.

Cautions

Cautions alert the technician to special conditions that could injure personnel, damage equipment, or reduce a component's mechanical integrity. Cautions are also used to alert the technician to unsafe practices or the need for special protective equipment or specific materials. In this manual, a caution box indicates a potentially hazardous situation which, if not avoided, may result in minor or moderate injury.

Notice of Trademark, Copyright, and Limitations

Copyright © 2009 Solutions With Innovation LLC; D.B.A. Innovative Solutions
All rights reserved.

Performance specifications are effective with date of issue and are subject to change without notice. Innovative Solutions reserves the right to make changes to the product described in this manual at any time without notice. Innovative Solutions makes no warranty with respect to the accuracy of the information in this manual.

Warranty

All Innovative Solutions mechanical level and flow controls are warranted free of defects in materials or workmanship for one full year from the date of original factory shipment.

If returned within the warranty period; and, upon factory inspection of the control, the cause of the claim is determined to be covered under the warranty; then, Innovative Solutions will repair or replace the control at no cost to the purchaser (or owner) other than transportation.

Innovative Solutions shall not be liable for misapplication, labor claims, direct or consequential damage or expense arising from the installation or use of equipment. There are no other warranties expressed or implied, except special written warranties covering some Innovative Solutions products.

Quality Assurance

The quality assurance system in place at Innovative Solutions guarantees the highest level of quality throughout the company. We are committed to providing full customer satisfaction both in quality products and quality service.

MODEL L007

SIDE MOUNTED LIQUID LEVEL FLOAT SWITCH

Table of Contents

1.0 Installation

1.1 Unpacking.....	1
1.2 Before You Begin	1
1.2.1 Site Preparation.....	1
1.2.2 Equipment and Tools	1
1.3 Mounting.....	2
1.3.1 Threaded Mounting.....	2
1.4 Wiring	2

2.0 Preventative Maintenance

2.1 What to do.....	3
2.1.1 Inspect Connections Monthly	3
2.1.2 Inspect Entire Model L007 Unit Periodically	3
2.2 What to Avoid.....	3

3.0 Reference Information

3.1 Description	4
3.2 Theory of Operation	4
3.3 Troubleshooting.....	4
3.3.1 External Causes	4
3.3.2 Model L007 Causes.....	5
3.4 Agency Approvals.....	6
3.5 Specifications	7
3.5.1 Physical Specifications	7
3.5.2 Electrical Specifications.....	7
3.5.3 Dimensional Specifications.....	8
3.6 Model Numbers.....	10

1.0 Installation

This section provides detailed procedures for properly installing the Model L007 Liquid Level Switch.

Caution: If equipment is used in a manner not specified by manufacturer, protection provided by equipment may be impaired.

1.1 Unpacking

Unpack the instrument carefully. Inspect all units for damage. Report any concealed damage to the carrier within 24 hours. Ensure that all components have been removed from the packing material. Check all contents against the packing list and report any discrepancies to the factory. Record the serial and model numbers for future reference when ordering parts.

Model Number _____

Serial Number _____

1.2 Before You Begin

Caution: During the installation of Model L007, the float and pivot area must be kept free of metallic particles that might be attracted to the magnet.

1.2.1 Site Preparation

1. Ensure that the length and the inside diameter of the mounting is sized correctly for the Model L007. See dimensional information on page 8 for requirements.
2. Ensure that the mounting or coupling is within 3° of horizontal.

1.2.2 Equipment and Tools

No special equipment or tools are required to install the Model L007 Liquid Level Switch. The following items are recommended:

- Wrenches, thread sealant, gaskets and/or bolting as appropriate for the process connection.
- Wrench
- Level

1.3 Mounting

The Model L007 Liquid Level Switch is available with a variety of threaded mounting bushings.

1.3.1 Threaded Mounting

Apply either Teflon[®] tape or appropriate thread sealant to mounting threads to prevent galling. Engage thread by hand to avoid damage. Using a wrench, rotate the unit clockwise until threads are tight in mounting. Ensure that the N.O. marking on body is upward for normally opened operation on models with SPST switches. For normally closed operation, ensure that the N.C. marking is upward.

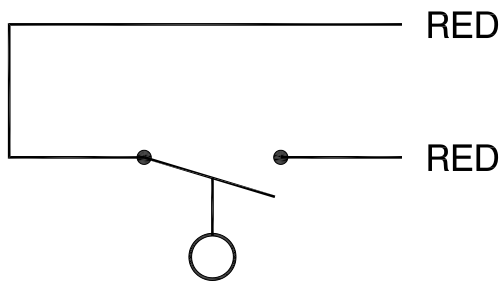


Fig.1a - Normally Open

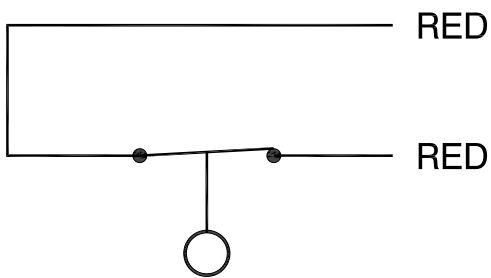


Fig.1b - Normally Closed

Figure 1a & b
SPST wiring diagram
Dry Condition

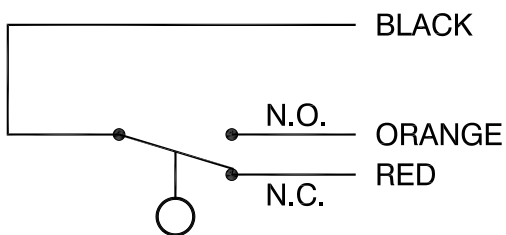


Figure 2
SPDT wiring diagram
Dry Condition

1.4 Wiring

1. SPST reed switch: Connect wiring to red switch leads or terminals per wiring diagram. See figure 1a & 1b
2. SPDT reed switch: Connect wiring to proper switch leads or terminals per wiring diagram. See figure 2.

NOTE: Observe all applicable electrical codes and proper wiring procedures.

Contact Protection:

In order to take advantage of the long life, highly reliable characteristics of a reed switch, it is essential to provide protection when switching inductive loads.

When current is interrupted, the inductance of the load generates a high frequency voltage, which appears across the switch contacts. If the voltage is large enough, it can cause arcing. Arcing can cause the contacts to weld to each other resulting in unreliable switching performance. It is essential to protect the circuit by suppressing the voltage to prevent arcing. This can be easily achieved through the use of a diode for DC circuits (Fig.3) and a resistor-capacitor network for AC circuits (Fig.4).

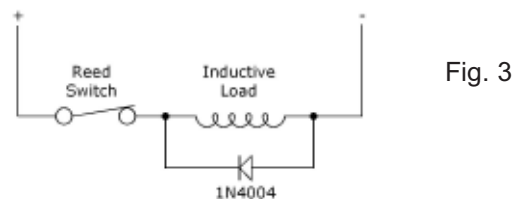


Fig. 3

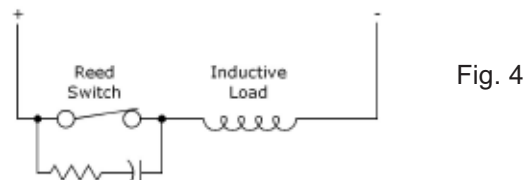


Fig. 4

2.0 Preventive Maintenance

Periodic inspections are a necessary means to keep your level control in good working order. This control is a safety device that protects the valuable equipment it serves. A systematic program of preventive maintenance should be implemented when the control is placed into service. If the following instructions are observed, your control will provide reliable protection of your equipment for many years.

2.1 What to Do

2.1.1 Inspect Connections Monthly

L007 level switches may sometimes be exposed to excessive heat or moisture. Under such conditions insulation on electrical wires may become brittle, eventually breaking or peeling away. The resulting bare wires can cause short circuits.

Check wiring carefully and replace at first sign of brittle insulation.

Check all electrical connections to ensure that they are tight. Check wiring carefully and repair or replace if necessary.

2.1.2 Inspect Entire Model L007 Unit Periodically

A periodic cleaning of the float, pivot and magnet assembly will ensure continued free movement of the mechanism.

2.2 What to Avoid

1. NEVER leave the switch wiring exposed to the elements.
2. NEVER place a jumper wire across terminals to “cut-out” the control.
3. NEVER use in systems containing iron particles. The magnet in the float assembly can attract the particles and become jammed.

3.0 Reference Information

This section presents an overview of the operation of the Model L007 Liquid Level Switches, including information on troubleshooting common problems, maintenance procedures, listings of agency approvals, and detailed physical, functional, and performance specifications.

3.1 Description

The Model L007 Liquid Level Switches are float actuated devices designed for horizontal mounting in a tank or process vessel through threaded or flanged connections. This low cost switch is ideal for OEM applications where a single point high or low level alarm is desired.

3.2 Theory of Operation

Switching action is achieved through the use of a magnet attached to the float assembly and its interaction with a switch mechanism. Separating the float magnet and the switch is a non-magnetic pressure barrier.

As the liquid level changes, the float along with the float magnet moves. The magnetic field of the float magnet causes a change of state of the switch, making or breaking an electrical circuit.

3.3 Troubleshooting

The Model L007 Liquid Level Switch is designed and engineered for trouble-free operation. Common problems are discussed in terms of their symptoms and corrective actions as recommended.

3.3.1 External Causes

Usually the first indication of improper operation is failure of the controlled equipment to function (e.g., pump will not start (or stop), signal lamps fail to light, etc). When these symptoms occur, whether at the time of installation or during routine service thereafter, check for the following potential external causes first:

- Blown fuses
- Tripped reset button(s)
- Open power switch
- Faulty equipment controlled by level switch
- Defective wiring to level switch

3.3.2 Model L007 Causes


If a thorough inspection of these possible conditions fails to locate the cause of the problem, proceed to a check of the Model L007's switch mechanism.

1. Disconnect power to the level switch.
2. Use an electrical continuity checker to determine if the switch is electrically functional. Move the float to activate switch. If the switch does not operate properly when activated, the entire level switch must be replaced.
3. If the float does not move freely or binds, remove level switch from service. Check the float assembly for obstructions or accumulation of particles which may cause binding. If binding is present in the float assembly and cannot be cleared by normal cleaning procedures, the entire control must be replaced.
4. If the complete Model L007 level switch operates properly when removed from service, check to ensure that liquid is entering the tank or vessel. A closed valve or clogged pipeline may prevent movement of the liquid in the vessel.
5. Check the float to make sure it is buoyant in the liquid (tank or vessel must have adequate level).
6. If the float is determined to be filled with liquid or is collapsed, the entire level switch may be replaced. Do not attempt to repair the float.

If all of the components of the level switch are in operating condition, the trouble is likely located external to the level switch. Repeat inspection of external conditions as described in Section 3.3.1.

NOTE: When in doubt about the condition or performance of a Model L007 control, consult the factory for further instructions.

3.4 Agency Approvals

AGENCY	APPROVED MODEL	FILE NUMBER	AREA CLASSIFICATION
UL 	L7: L007 Series	E203716	Recognized under UL508 motor controllers

3.5 Specifications

3.5.1 Physical Specifications


Measured Variable	Liquid level
Physical Range	N/A
Minimum Specific Gravity	0.80
Float Material	316/316L stainless steel, polypropylene, polysulfone, nylon, or PVC
Mounting Connection Material	316/316L stainless steel, polypropylene, polysulfone, nylon, or PVC
Trim Material	N/A
Process Connections	1/2" NPT, 3/8-24, 1/2-13, 5/8-11

Process Temperature Range	-40° to +120° F (-40° to +50° C) for plastic -40° to +300° F (-40° to +149° C) for stainless steel
Ambient Temperature Range	-40° to +40° F (-40° to +50° C)
Maximum Process Pressure	100 psi (6.9 bar) for plastic & 300 psi (20 bar) for stainless steel


3.5.2 Electrical Specifications

Signal Output	Switch closure
Type of Contacts	SPST or SPDT
Type of Switches	Hermetically sealed reed switch
Switch Ratings	SPST 100 VA, 240 VAC/VDC maximum, 1 Amp maximum SPST 50 VA, 240 VAC/VDC maximum, 0.5 Amp maximum SPDT 3 VA, 30 VAC/VDC maximum, 0.2 Amp maximum
Electrical Connection	Free Leads, 22 AWG UL1061, UL1213, or UL3266


3.5.3 Dimensional Specifications – inches

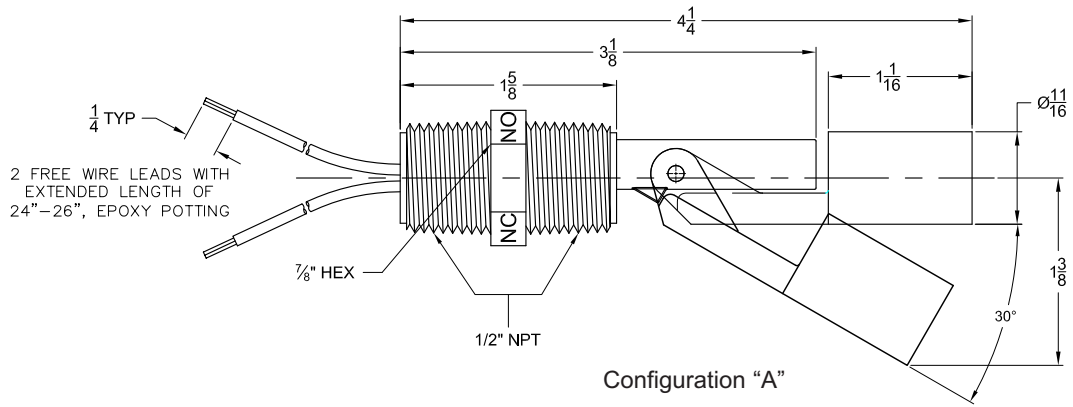

Configuration "A"



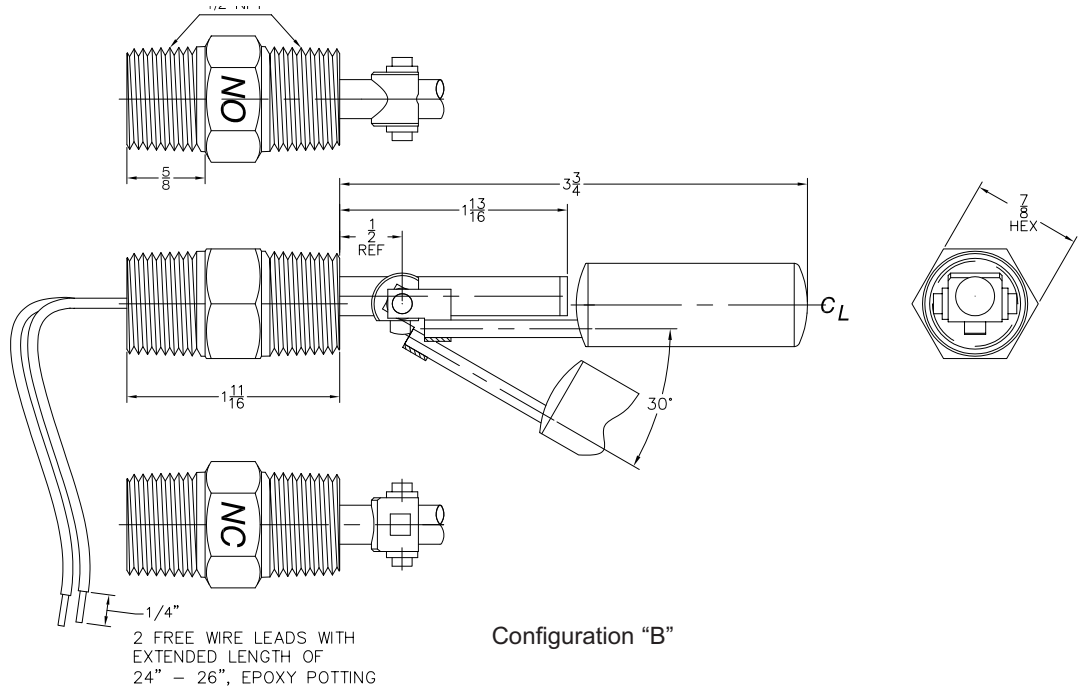


Configuration "B"

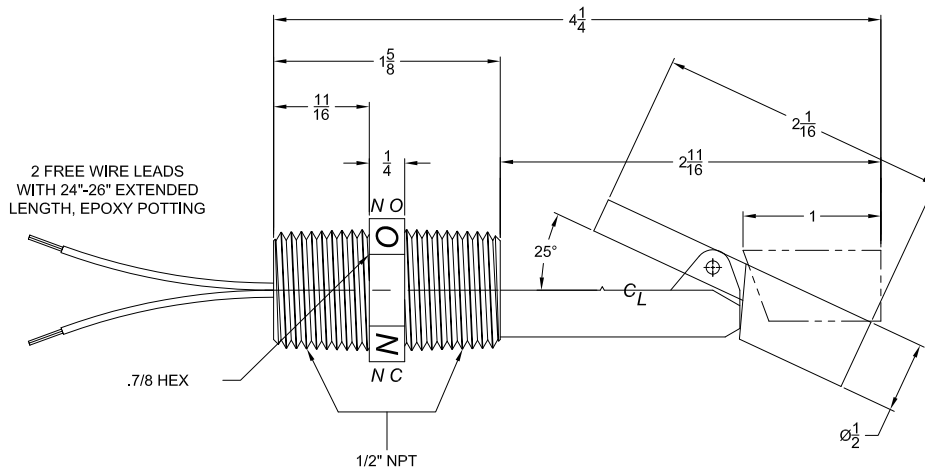

Configuration "C"

3.5.3 Dimensional Specifications – inches

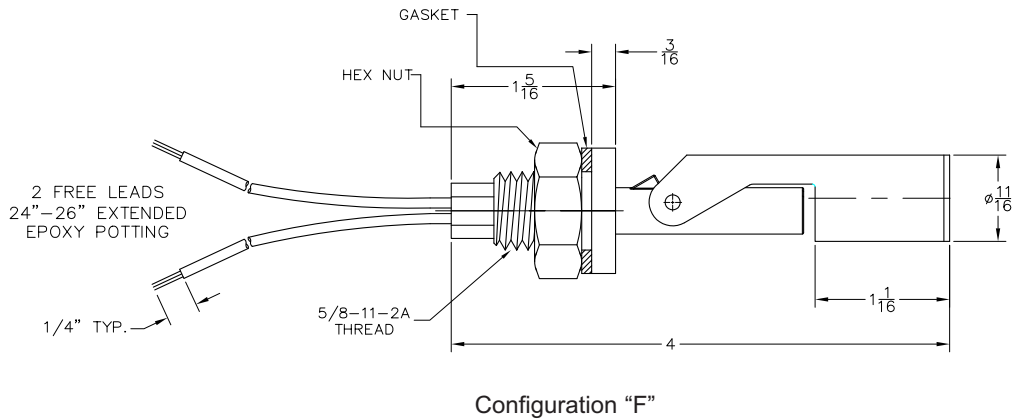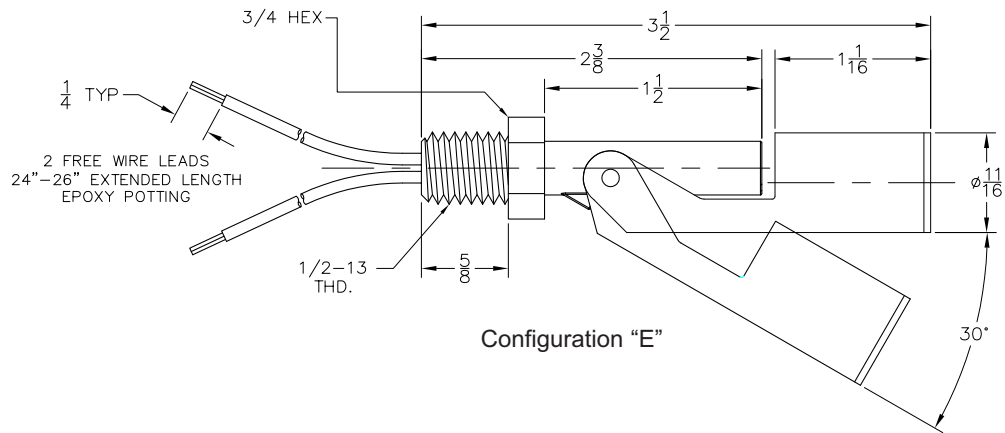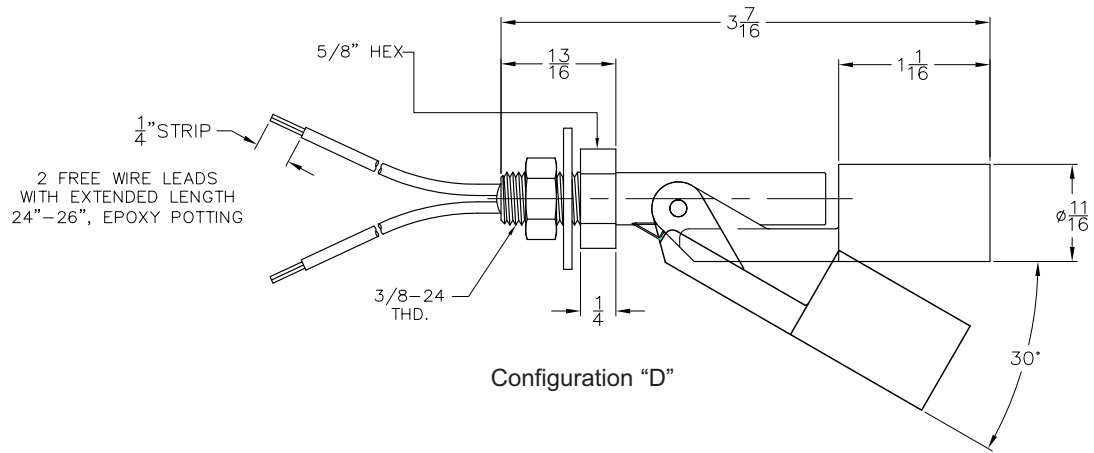

3.6 Model Numbers

TECHNOLOGY TYPE

L	Liquid level sensor
---	---------------------

FLOAT

007	Series, minimum s.g. 0.80
-----	---------------------------

IDENTIFIER

-	Standard Product
C	Custom Product

MOUNTING SIZE

04	1/2" NPT threads
18	3/8"-24 threads
20	1/2"-13 threads
22	5/8"-11 threads

HOUSING / BODY MATERIAL


02	Polypropylene
08	316 Stainless Steel
05	PVC
18	Nylon
22	Polysulfone

FLOAT MATERIAL

02	Polypropylene
08	316 Stainless Steel
05	PVC
18	Nylon
22	Polysulfone

ELECTRICAL OPTION

03	50VA, 240VAC/VDC max. 0.5A max
04	100VA, 240VAC/VDC max. 1A max.
06	3VA 30VAC/VDC max. 0.2A max.



Notes

Service Policy

Owners of Innovative Solutions controls may request the return of a control or any part of a control for complete rebuilding or replacement. They will be rebuilt or replaced promptly. Controls returned under our service policy must be returned by Prepaid transportation. Innovative Solutions will repair or replace the control at no cost to the purchaser (or owner) other than transportation if:

1. Returned within the warranty period; and
2. The factory inspection finds the cause of the claim to be covered under the warranty.

If the trouble is the result of conditions beyond our control; or, is NOT covered by the warranty, there will be charges for labor and the parts required to rebuild or replace the equipment.

In some cases it may be expedient to ship replacement parts; or, in extreme cases a complete new control, to replace the original equipment before it is returned. If this is desired, notify the factory of both the model and serial numbers of the control to be replaced. In such cases, credit for the materials returned will be determined on the basis of the applicability of our warranty.

No claims for misapplication, labor, direct or consequential damage will be allowed.

Return Material Procedure

So that we may efficiently process any materials that are returned, it is essential that a "Return Material Authorization" (RMA) number be obtained from the factory, prior to the material's return. This is available through Innovative Solutions local representative or by contacting the factory. Please supply the following information:

1. Company Name
2. Description of Material
3. Serial Number
4. Reason for Return
5. Application

Any unit that was used in a process must be properly cleaned in accordance with OSHA standards, before it is returned to the factory.

A Material Safety Data Sheet (MSDS) must accompany material that was used in any media.

All shipments returned to the factory must be by prepaid transportation.

All replacements will be shipped F.O.B. factory.

The logo for Innovative Solutions features the word "Innovative" in black and "Solutions" in red, with a stylized sunburst graphic behind the text.

Innovative Solutions

60 Great Hill Road Naugatuck, CT 06770
ph: 203-729-6434 fax: 203-729-6696

BULLETIN: IS-9130.0
EFFECTIVE: April 2008